


## 1. 电路图参数表(SDL-300U~1200U 400V)

符号/SYMBOL 型号/MODE	Ⓐ	Ⓑ	Ⓒ	Ⓒ <sup>2</sup>	Ⓒ <sup>1</sup>	Ⓓ	Ⓔ	Ⓕ	Ⓖ	Ⓗ	Ⓘ	Ⓛ	Ⓚ	Ⓛ	Ⓜ	Ⓝ	Ⓞ	Ⓟ
SDL-20U	2.5	16	6	6	16	1.5	0.18-0.25	0.19	0.05	0.15	2.5	3.5-5	3.8	1.5	2.2	2.5	2.2	3.3
SDL-40U	2.5	16	6	6	16	1.5	0.28-0.4	0.38	0.12	0.33	2.5	3.5-5	3.8	1.5	2.2	2.5	3.0	4.5
SDL-80U	2.5	16	10	6	16	1.5	0.28-0.4	0.38	0.12	0.33	2.5	3.5-5	3.8	1.5	2.2	2.5	3.9	6.0
SDL-120U	2.5	16	10	6	16	1.5	0.28-0.4	0.38	0.12	0.33	2.5	3.5-5	3.8	1.5	2.2	2.5	3.9	6.0
SDL-160U	2.5	16	16	6	16	1.5	0.28-0.4	0.38	0.12	0.33	2.5	3.5-5	3.8	1.5	2.2	2.5	6.0	9.0
SDL-230U	2.5	25	16	6	16	1.5	0.28-0.4	0.38	0.12	0.33	2.5	3.5-5	3.8	1.5	3.7	2.5	6.0	9.0
SDL-300U	6.0	32	25	6	16	1.5	0.45-0.63	0.54	0.18	0.48	2.5	3.5-5	3.8	1.5	3.7	4.0	12.0	18.0
SDL-450U	6.0	32	25	6	16	1.5	0.45-0.63	0.54	0.18	0.48	2.5	3.5-5	3.8	1.5	3.7	4.0	12.0	18.0
SDL-600U	6.0	40	32	6	16	1.5	1.1-1.6	1.4	0.55	1.3	2.5	3.5-5	3.8	1.5	3.7	6.0	18.0	27.0
SDL-750U	6.0	40	32	6	16	1.5	1.1-1.6	1.4	0.55	1.3	2.5	3.5-5	3.8	1.5	3.7	6.0	18.0	27.0
SDL-900U	10.0	60	50	6	16	1.5	1.1-1.6	1.4	0.55	1.3	2.5	5.5-8	6.0	2.4	5.9	6.0	18.0	27.0
SDL-1200U	10.0	60	50	10	16	1.5	2.2-3.2	2.5	1.1	2.4	2.5	5.5-8	6.0	2.4	5.9	4.0	12.0*2	18.0x2

- Ⓐ 主电源线径      Ⓑ 主电源开关      Ⓒ<sup>1</sup> 电热断路器      Ⓒ<sup>2</sup> 风车断路器      Ⓓ 干燥风车线径  
 Ⓔ 干燥风车负载器      Ⓕ 干燥风车负载器设定      Ⓖ 干燥风车功率      Ⓗ 干燥风车电流      Ⓘ 吸料风车线径  
 Ⓛ 吸料风车负载器      Ⓚ 吸料风车负载器设定      Ⓛ 吸料风车功率      Ⓜ 吸料风车电流      Ⓝ 电热线径  
 Ⓞ 电热功率      Ⓟ 电热电流


## 2. 主电路图(SDL-300U~1200U 400V)

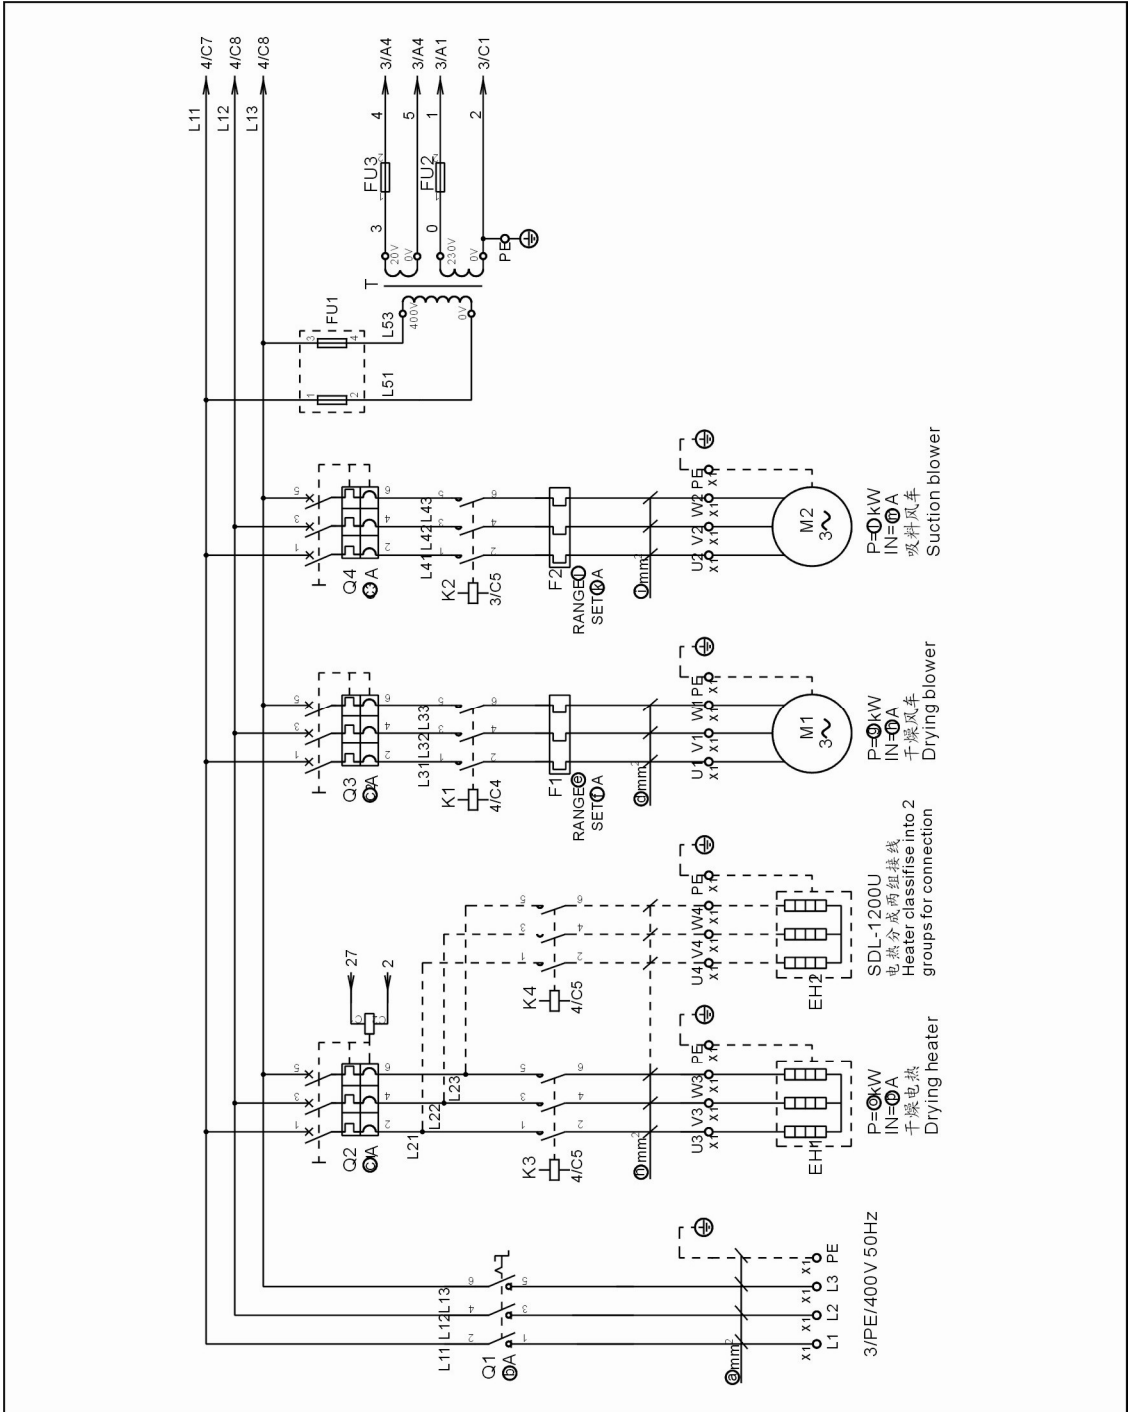





## 5. 电气元件布置图(SDL-300U~1200U 400V)

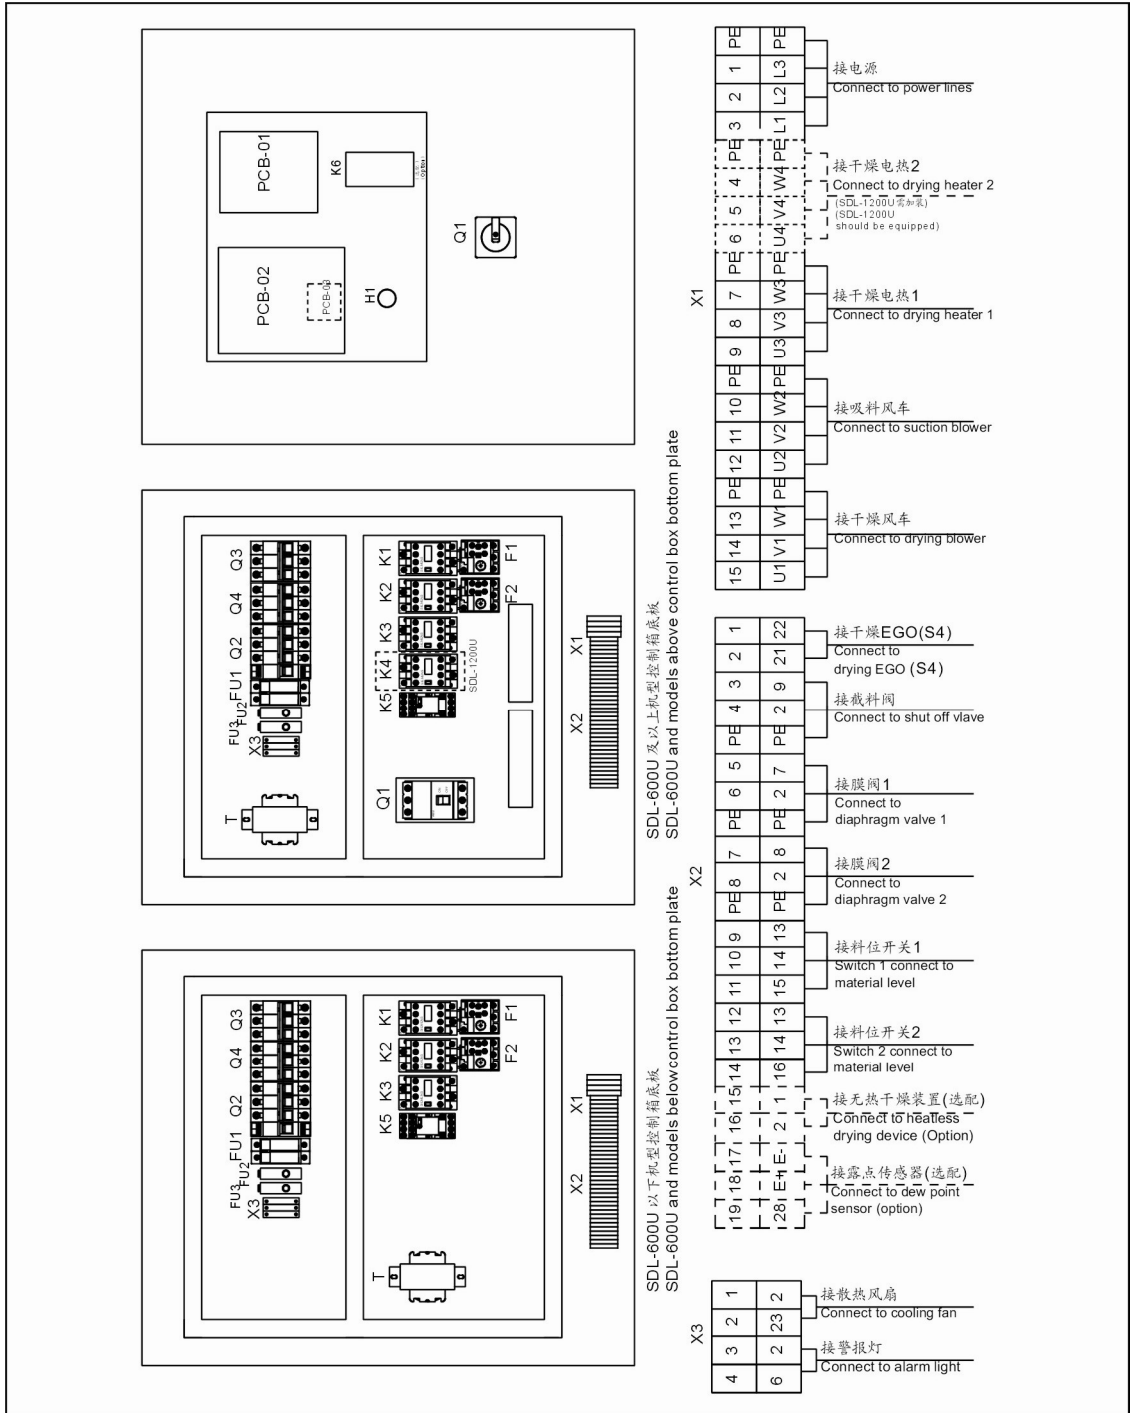

## 6. 电气组件明细表(SDL-300U/450U 400V)

序号	符号	名称	SDL-300U/450U	
			规格	物料编号
1	Q1	主电源开关	32A	YE10220300000
2	Q2	断路器*	25A	YE40602500000
3	-	励磁脱扣器	230VAC 50/60Hz	YE40023560000
4	Q3	断路器*	5A	YE40603000000
5	Q4	断路器*	15A	YE40601500000
6	K1	接触器*	220V 50/60Hz	YE00601521000
7	K2	接触器*	220V 50/60Hz	YE00601521000
8	K3	接触器*	220V 50/60Hz	YE00602622000
9	K5	中间继电器*	230V 50/60Hz	YE03270700000
10	K6	无热再生装置	230V 50/60Hz	-
11	K7	露点计表	230V 50/60Hz	YE85122000100
12	T	互感变压器*	IN=400V OUT=230/20V 800mA	YE70402300600
13	F1	热过载继电器*	0.45~0.63A	YE01161450000
14	F2	热过载继电器*	3.5~5A	YE01160350000
15	FU1	熔断器座**	2P	YE41032200000
16	-	熔断器芯	2A	YE46002000000
17	FU2	熔断器**	2A	YE46002000000
18	FU3	熔断器**	-	YE46002000000
19	-	熔芯	0.5A	YE46630500000
20	S3	露点变送器	POWER=24VDC OUT=4-20mA	YE10041100000
21	S4	温度保护器*	115-320°	BH90115000150
22	S5	热电偶	K	BE90802000050
23	PCB-01	微电脑控制板*	V1.1 18VAC	YE80101100000
24	PCB-02	微电脑控制板*	230VAC50/60Hz	YE80001100000
25	PCB-03	微电脑控制板	-	YE80001100100
26	H1	蜂鸣器	3-24VDC	YE84002700000
27	H2	警报指示灯	230VAC 50Hz	YE83305100200
28	FM	风扇	230VAC 40W	YM60121200400
29	Y1 Y2 Y3	电磁阀*	230VAC 50/60Hz	YE32051800300
30	M1	风车*	400V 50/60Hz 0.18kW	-
31	M2	风车*	400V 50/60Hz 1.5kW	-
32	EH1	电热管**	400V 50/60Hz 12.0kW	-
33	X1	端子排	-	YE61250040000
34	-	-	-	YE61253500000
35	-	-	-	YE61040000000
36	-	-	-	YE61043500000
37	-	-	-	YE61060000000
38	-	-	-	YE61063500000
39	X2	端子排	-	YE61250040000

40	-	-	-	YE61253500000
41	-	-	-	YE61250040000
42	-	-	-	YE61250040000
43	X3	端子排	-	YE61250040000
44	X4 X5	重载接头	4P 10A	YE68041000100

\*表示可能损坏的项目；\*\*表示较可能损坏的项目，建议备份。

请在下单采购零配件之前，先确认说明书版本号，以确保零配件物料号与实物一致。

## 7. 电气组件明细表(SDL-600U/750U 400V)

序号	符号	名称	SDL-600U/750U	
			规格	物料编号
1	Q1	主电源开关	40A	YE41104000000
2	Q2	断路器*	32A	YE40603200000
3	-	励磁脱扣器	230VAC 50/60Hz	YE40023560000
4	Q3	断路器*	5A	YE40603000000
5	Q4	断路器*	15A	YE40601500000
6	K1	接触器*	220V 50/60Hz	YE00601500000
7	K2	接触器*	220V 50/60Hz	YE00601521000
8	K3	接触器*	220V 50/60Hz	YE00602822000
9	K5	中间继电器*	230V 50/60Hz 12A	YE03270700000
10	K6	无热再生装置	230V 50/60Hz	-
11	K7	露点计表	230V 50/60Hz	YE85122000100
12	T	互感变压器*	IN=400V OUT=230/20V 800mA	YE70402300600
13	F1	热过载继电器*	1.1~1.6A	YE01160110000
14	F2	热过载继电器*	3.5~5A	YE01160350000
15	FU1	熔断器座**	2P	YE41032200000
16	-	熔断器芯	2A	YE46002000000
17	FU2	熔断器**	2A	YE46002000000
18	FU3	熔断器**	-	YE46002000000
19	-	熔芯	0.5A	YE46630500000
20	S3	露点变送器	POWER=24VDC OUT=4-20mA	YE10041100000
21	S4	温度保护器*	115-320°	BH90115000150
22	S5	热电偶	K	BE90802000050
23	PCB-01	微电脑控制板*	V1.1 18VAC	YE80101100000
24	PCB-02	微电脑控制板*	-	YE80001100000
25	PCB-03	微电脑控制板	-	YE80001100100
26	H1	蜂鸣器	3-24VDC	YE84002700000
27	H2	警报指示灯	230VAC 50Hz	YE83305100200
28	FM	风扇	230VAC 40W	YM60121200400
29	Y1 Y2 Y3	电磁阀*	230VAC 50/60Hz	YE32051800300
30	M1	风车*	400V 50/60Hz 0.55kW	-
31	M2	风车*	400V 50/60Hz 1.5kW	-
32	EH1	电热管**	400V 50/60Hz 18.0kW	-
33	X1	端子排	-	YE61250040000
34	-	-	-	YE61253500000
35	-	-	-	YE61060000000
36	-	-	-	YE61063500000
37	X2	端子排	-	YE61250040000
38	-	-	-	YE61253500000
39	-	-	-	YE61250040000



40	-	-	-	YE61250040000
41	X3	端子排	-	YE61250040000
42	X4 X5	重载接头	4P 10A	YE68041000100

\*表示可能损坏的项目；\*\*表示较可能损坏的项目，建议备份。

请在下单采购零配件之前，先确认说明书版本号，以确保零配件物料号与实物一致。

## 8. 电气组件明细表(SDL-900U 400V)

序号	符号	名称	SDL-900U	
			规格	物料编号
1	Q1	主电源开关	60A	YE41106000000
2	Q2	断路器*	50A	YE40605000000
3	-	励磁脱扣器	230VAC 50/60Hz	YE40023560000
4	Q3	断路器*	5A	YE40603000000
5	Q4	断路器*	15A	YE40601500000
6	K1	接触器*	220V 50/60Hz	YE00601521000
7	K2	接触器*	220V 50/60Hz	YE00601621000
8	K3 K4	接触器*	220V 50/60Hz	YE00602822000
9	K5	中间继电器*	230V 50/60Hz 12A	YE03270700000
10	K6	无热再生装置	230V 50/60Hz	-
11	K7	露点计表	230V 50/60Hz	YE85122000100
12	T	互感变压器*	IN=400V OUT=230/20V 800mA	YE70402300600
13	F1	热过载继电器*	1.1~1.6A	YE01160110000
14	F2	热过载继电器*	5.5~8A	YE01160550000
15	FU1	熔断器座**	2P	YE41032200000
16	-	熔断器芯	2A	YE46002000000
17	FU2	熔断器**	2A	YE46002000000
18	FU3	熔断器**	-	YE46002000000
19	-	熔芯	0.5A	YE46630500000
20	S3	露点变送器	POWER=24VDC OUT=4-20mA	YE10041100000
21	S4	温度保护器*	115-320°	BH90115000150
22	S5	热电偶	K	BE90802000050
23	PCB-01	微电脑控制板*	V1.1 18VAC	YE80101100000
24	PCB-02	微电脑控制板*	-	YE80001100000
25	PCB-03	微电脑控制板	-	YE80001100100
26	H1	蜂鸣器	3-24VDC	YE84002700000
27	H2	警报指示灯	230VAC 50Hz	YE83305100200
28	FM	风扇	230VAC 40W	YM60121200400
29	Y1 Y2 Y3	电磁阀*	230VAC 50/60Hz	YE32051800300
30	M1	风车*	400V 50/60Hz 0.55kW	-
31	M2	风车*	400V 50/60Hz 2.4kW	-
32	EH1	电热管**	400V 50/60Hz 18kW	-
33	X1	端子排	-	YE61250040000
34	-	-	-	YE61253500000
35	-	-	-	YE61040000000
36	-	-	-	YE61043500000
37	-	-	-	YE61100000000
38	-	-	-	YE61103500000
39	X2	端子排	-	YE61250040000

40	-	-	-	YE61253500000
41	-	-	-	YE61250040000
42	-	-	-	YE61250040000
43	X3	端子排	-	YE61250040000
44	X4 X5	重载接头	4P 10A	YE68041000100

\*表示可能损坏的项目；\*\*表示较可能损坏的项目，建议备份。

请在下单采购零配件之前，先确认说明书版本号，以确保零配件物料号与实物一致。

## 9. 电气组件明细表(SDL-1200U 400V)

序号	符号	名称	SDL-1200U	
			规格	物料编号
1	Q1	主电源开关	60A	YE41106000000
2	Q2	断路器*	50A	YE40605000000
3	-	励磁脱扣器	230VAC 50/60Hz	YE40023560000
4	Q3	断路器*	10A	YE40600300000
5	Q4	断路器*	15A	YE40601500000
6	K1	接触器*	230V 50/60Hz	YE00601621000
7	K2	接触器*	230V 50/60Hz	YE00601621000
8	K3 K4	接触器*	230V 50/60Hz	YE00602622000
9	K5	中间继电器*	230V 50/60Hz 12A	YE03270700000
10	K6	无热再生装置	230V 50/60Hz	-
11	K7	露点计表	230V 50/60Hz	YE85122000100
12	T	互感变压器*	IN=400V OUT=230/20V 800mA	YE70402300600
13	F1	热过载继电器*	2.2~3.2A	YE01160220000
14	F2	热过载继电器*	5.5~8A	YE01160550000
15	FU1	熔断器座**	2P	YE41032200000
16	-	熔断器芯	2A	YE46002000000
17	FU2	熔断器**	2A	YE46002000000
18	FU3	熔断器**	-	YE46002000000
19	-	熔芯	0.5A	YE46630500000
20	S3	露点变送器	POWER=24VDC OUT=4-20mA	YE10041100000
21	S4	温度保护器*	115-320°	BH90115000150
22	S5	热电偶	K	BE90802000050
23	PCB-01	微电脑控制板*	V1.1 18VAC	YE80101100000
24	PCB-02	微电脑控制板*	-	YE80001100000
25	PCB-03	微电脑控制板	-	YE80001100100
26	H1	蜂鸣器	3-24VDC	YE84002700000
27	H2	警报指示灯	230VAC 50Hz	YE83305100200
28	FM	风扇	230VAC 40W	YM60121200400
29	Y1 Y2 Y3	电磁阀*	230VAC 50/60Hz	YE32051800300
30	M1	风车*	400V 50/60Hz 1.1kW	-
31	M2	风车*	400V 50/60Hz 2.4kW	-
32	EH1	电热管**	400V 50/60Hz 12kW	-
33	X1	端子排	-	YE61250040000
34	-	-	-	YE61253500000
35	-	-	-	YE61040000000
36	-	-	-	YE61043500000
37	-	-	-	YE61100000000
38	-	-	-	YE61103500000
39	X2	端子排	-	YE61250040000

40	-	-	-	YE61253500000
41	-	-	-	YE61250040000
42	-	-	-	YE61250040000
43	X3	端子排	-	YE61250040000
44	X4 X5	重载接头	4P 10A	YE68041000100

\*表示可能损坏的项目；\*\*表示较可能损坏的项目，建议备份。

请在下单采购零配件之前，先确认说明书版本号，以确保零配件物料号与实物一致。